


ALLEY (16' PUBLIC R.O.W.)

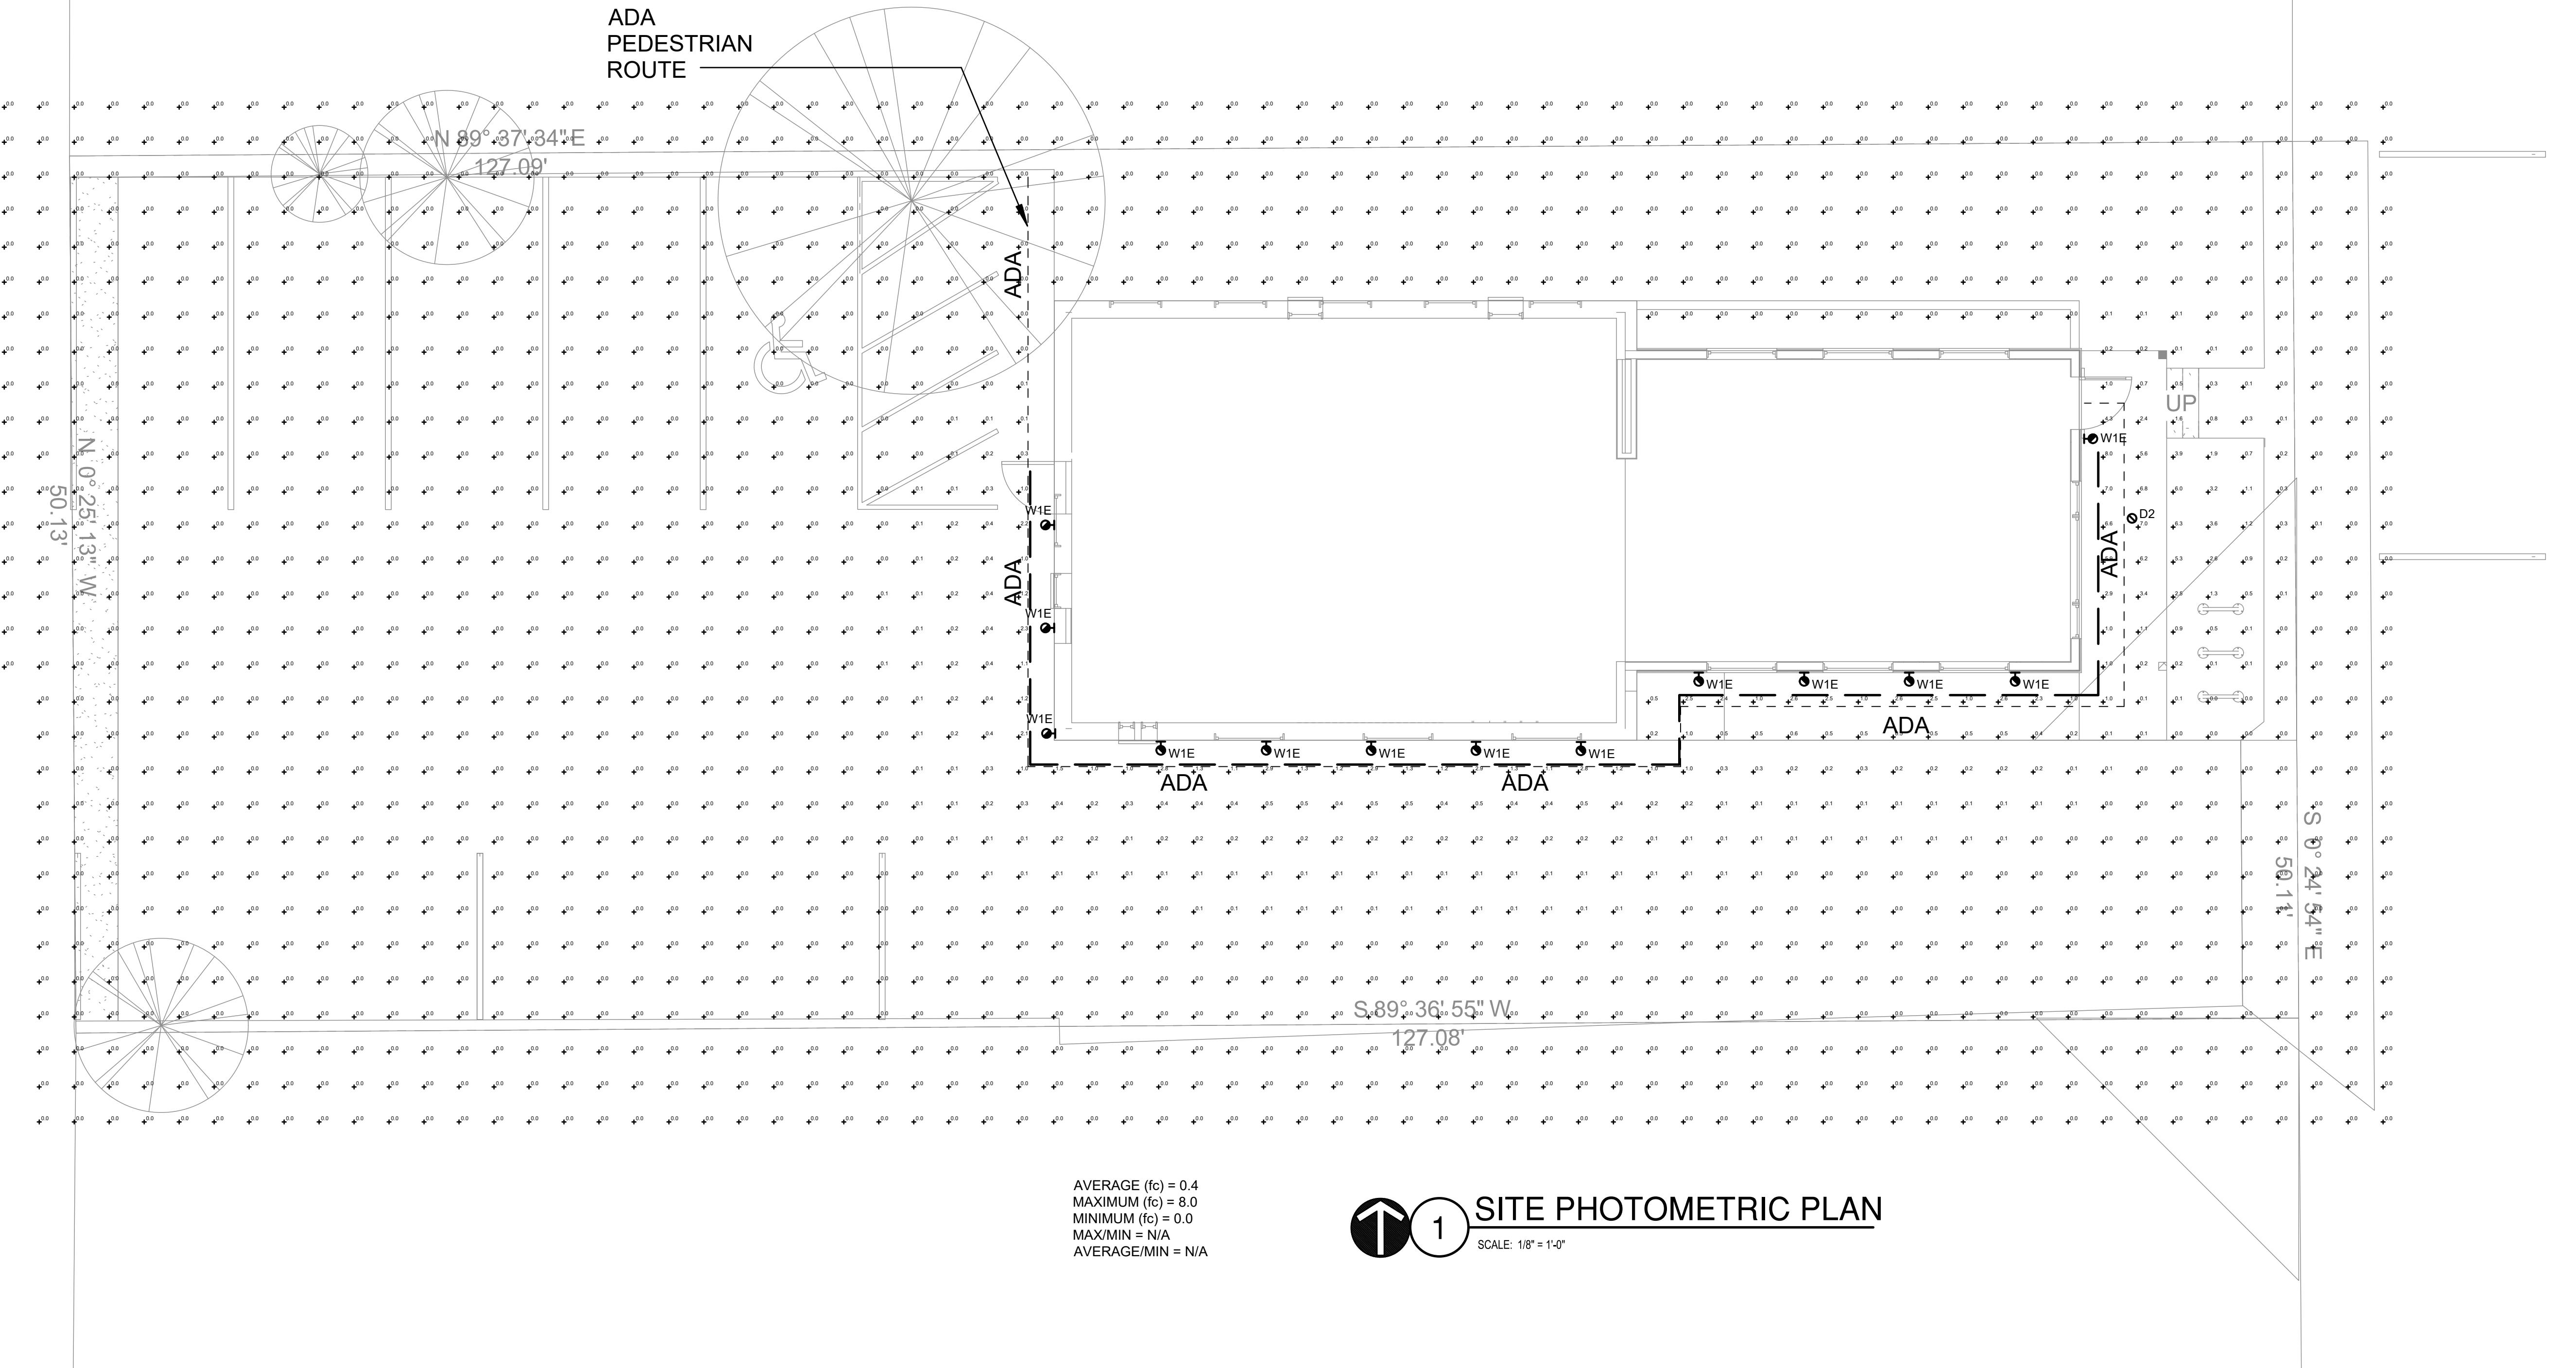

1 SITE PHOTOMETRIC PLAN

SCALE: 1/8" = 1'-0"

GENERAL NOTES (THIS SHEET)

- ILLUMINATION WITHIN THE SITE MUST COMPLY WITH THE 2015 INTERNATIONAL BUILDING CODE REQUIREMENT FROM SECTION 1006 - MEANS OF EGRESS ILLUMINATION. SECTION 1006. ILLUMINATION REQUIRED: THE MEANS OF EGRESS, INCLUDING THE EXIT DISCHARGE, SHALL BE ILLUMINATED AT ALL TIMES THE BUILDING IS OCCUPIED. SECTION 1006.2 ILLUMINATION LEVEL: THE MEANS OF EGRESS ILLUMINATION LEVEL SHALL NOT BE LESS THAN 1 FOOT-CANDLE (11 LUX) AT THE FLOOR LEVEL, AND CONTINUING TO THE "PUBLIC WAY".

1519 GENEVA ST
AURORA, CO 80010

PHOTOMETRIC PLAN
E3.0

ENGINEER
RAMIREZ,
JOHNSON, &
ASSOCIATES, LLC
3377 BLAKE ST,
SUITE 101
DENVER, CO 80205
P: 720.598.0774

DATE: 5-1-2020
PROJECT: 20.047
RELEASE:
100% CD 2020-5-1